

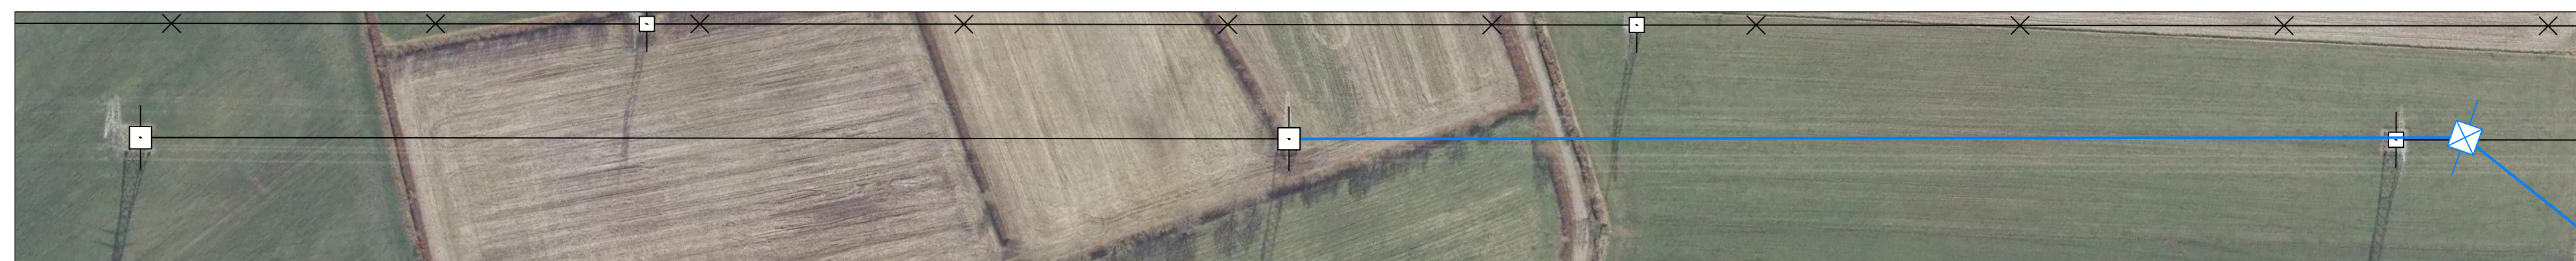
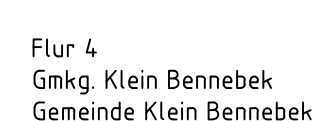


063a
WA140-42.00
DA/



Anlage 6.1
Blatt 25a/65



Mast Nr. 61 - Mast Nr. 63a (380-kV-Ltg. Nr.305)

DIN VDE-Bestimmung	: DIN VDE 0210/12.85
Masttyp	: D-2-D-000/C2 (Mast 061+062) D-2-D-2015.3 ZES (Mast 063a)
Beseilung Leiterseil	: 2x3x4 AL/ST 564/72, MZS=57,8N/mm²
Erdseil	: 2x AL/ST 95/55, dhgl. zu LS
Luftkabel/ sonstige Belegung	: DA = 6,50m (3000N) - (Mast 063a); DA = 5,65m (4100N) - (Mast 061); YK = 4,60m (2650N) - (Mast 062) + 4,20m (3600N) - (Mast 062)
Ketttenlänge	
Seitliche Überhöhung	: 1/4 m rechts — — — — — oder links — — — — — aufgenommen

Aufgestellt
Bayreuth, 04.12.2015

eqos Deut
Wolf
D-88

01	Umpl. Lfg. Nr.324	23.1
----	-------------------	------

	Umpl. L.fg. Nr.305	23.1
	Umpl. M063a	23.1

Zust.	Änderung	Da
-------	----------	----

11.2015	geka		Datum	Name
---------	------	--	-------	------

	Fachbereich TL	
		

		
Datum	Name	Urspr: